


Oxy-Coal Power Plant with CCS

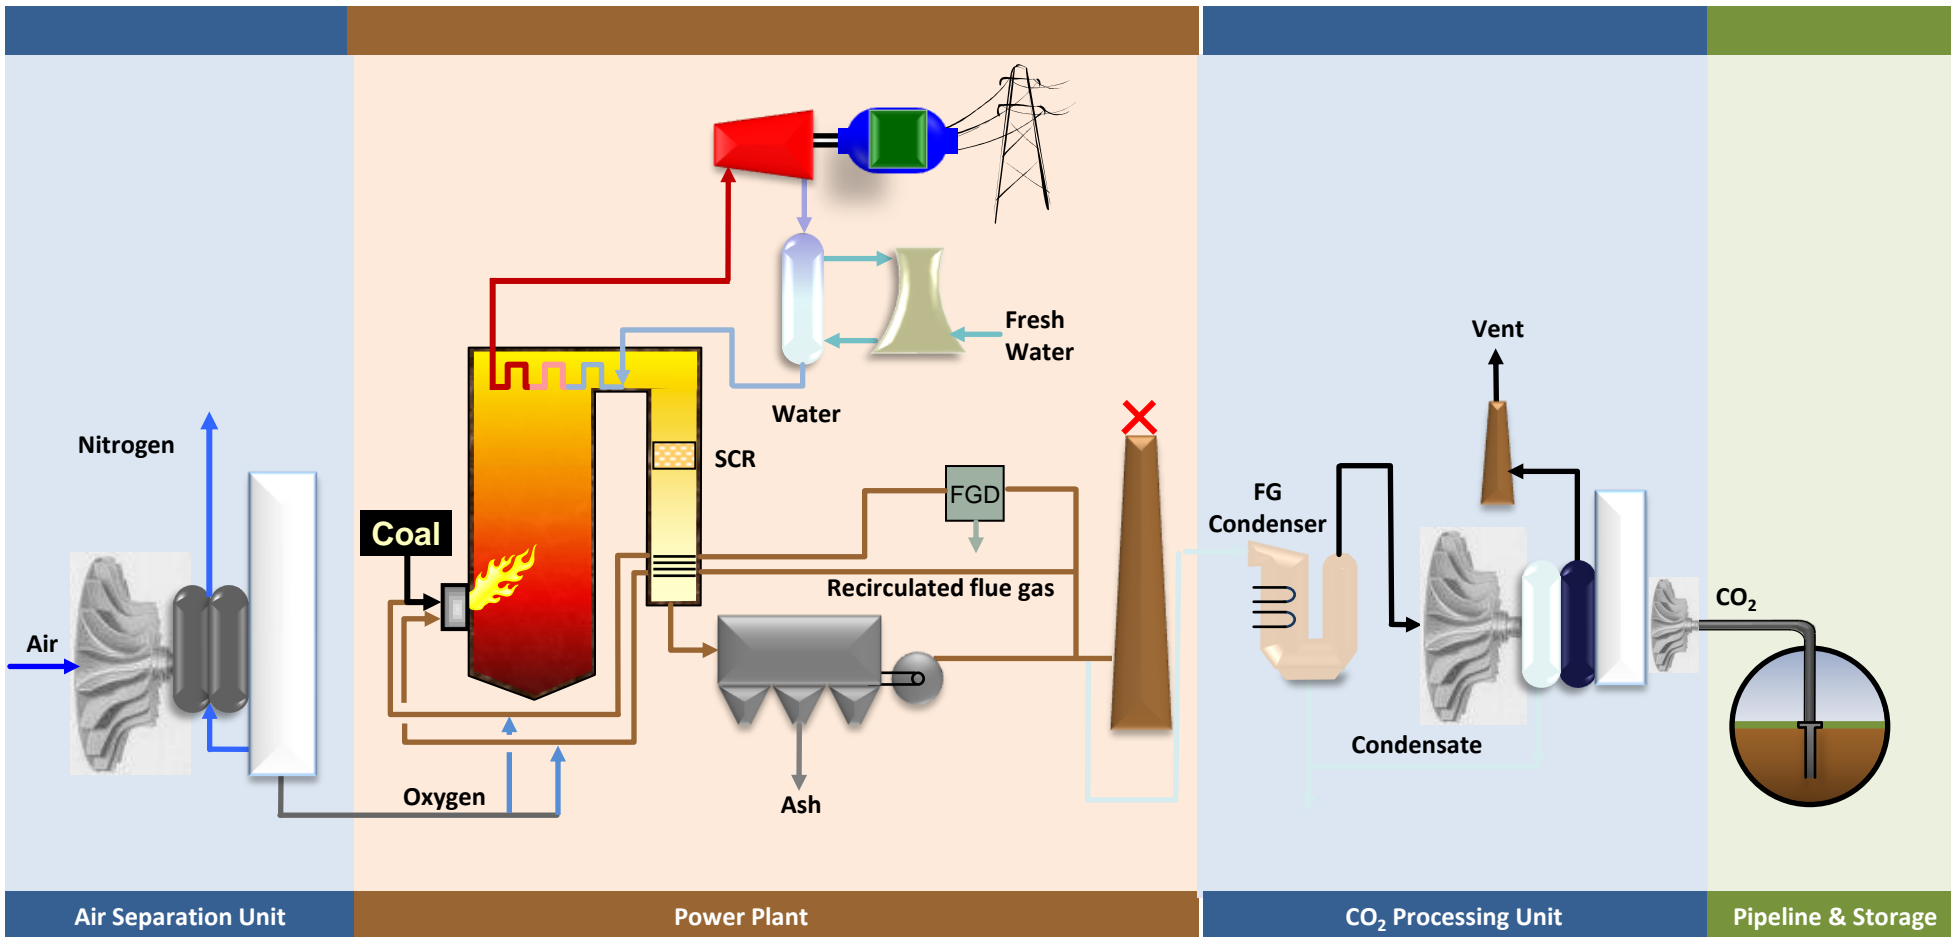

- ◆ With oxy-combustion, flue gas flow is reduced to ~1.3 MM lb/hr
- ◆ Flue gas is sent to CO₂ processing unit (CPU)
- ◆ After separating CO₂, vent gas is only 0.11 MM lb/hr