

# Simple Cycle SCR Designs

Presentation for

McIlvaine Hot Topic Hour

## *Air Pollution Control for Gas Turbines*

September 19, 2013

Bill Gretta, ENERActive Solutions, LLC

Asbury Park, NJ



# Outline

---

- Simple Cycle SCR System Overview
- SCR Design Conditions & Specifications
- Tempering Air
- Flow Modeling
- AIG Design & Ammonia Distribution
- Bypass and Structural Design


# Simple Cycle SCR Systems Overview

---

- ❑ Simple Cycle SCR pose more design challenges than combined cycle units
- ❑ Common Misconception...Simple Cycle SCR is a Commodity..
  - Add-on to a GT package to meet emissions requirements
- ❑ When treated as a commodity, details can and have been overlooked
- ❑ Performance problems can result in \$millions in lost generation (down time or de-rating), testing, investigations and repairs to get into compliance
- ❑ Proper specification and design is key to successful operation... **avoid “commoditization”**

# Simple Cycle SCR Design - Typical


---

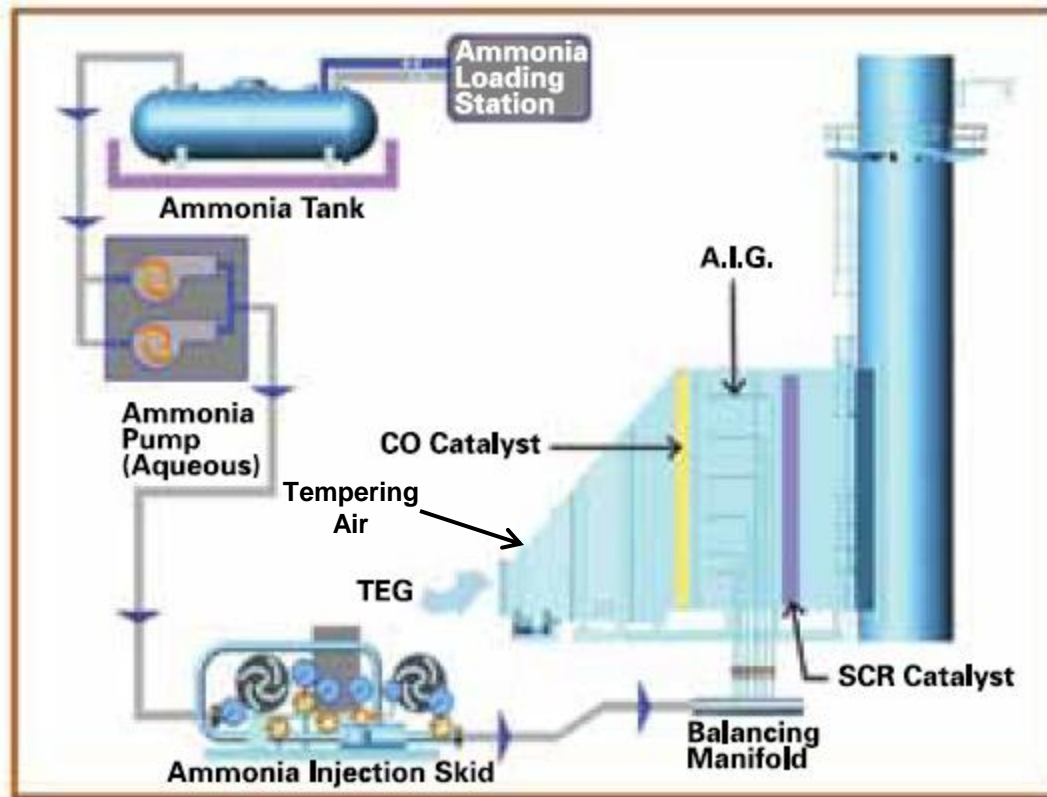

# Simple Cycle SCR Design Conditions

---

- ❑ Several Factors Dictate Design of SCR
  - Gas Flow...depends on size of engine
  - Engine exhaust NOx
  - Stack NOx (DeNOx) and NH<sub>3</sub> Slip...Local permit requirements
  - Flue gas Temperature
  - Footprint Available
    - Back Pressure

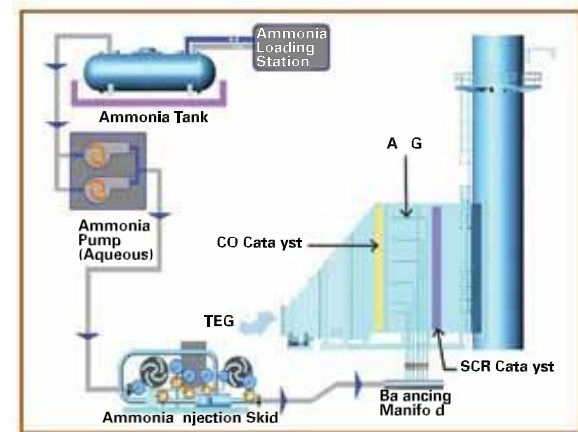

# Simple Cycle SCR Design Conditions

---

## Typical Values – GE LM6000

Parameter	Units	Value
Gas Flow	lb/hr	1,100,100
SCR Inlet NOx	ppm	25 (Natural Gas)*
SCR Outlet NOx	ppm	<2.5
Temperature	°F	750-800
Ammonia Slip	ppm	<5

\* Engine NOx can be adjusted by water injection

# Simple Cycle SCR – Water Injection for NOx Control

---

- ❑ Water Injection used to reduce engine NOx to 25 ppm
- ❑ GT Manufacturer sets limit on how much water can be added...~20 ppm may be lower limit
  - ❑ SCR Duty cannot be dramatically reduced
- ❑ Higher water injection will increase CO
- ❑ Balancing act between CO and NOx...and ammonia slip

# Simple Cycle SCR – Maintaining Performance

---

Pollutant	Maintainability
NO <sub>x</sub>	Outlet NO <sub>x</sub> usually controlled below 2.5ppm
NH <sub>3</sub> Slip	Depending on monitoring, can be very difficult to maintain 5 ppm if system problems exist
CO	Can be difficult to maintain if engine NO <sub>x</sub> is reduced too low with water injection (i.e. to maintain NH <sub>3</sub> slip)



# Simple Cycle SCR – Design Specs

---

- ❑ Give yourself some breathing room...
- ❑ If NO<sub>x</sub> permit limit is 2.5 ppm, set design point for SCR to something lower
  - ❑ The operating setpoint will be something lower than 2.5 ppm to avoid exceedances.
  - ❑ If inlet NO<sub>x</sub> is 25 ppm, then DeNO<sub>x</sub> is above 90%...ammonia slip could be an issue from the start.
- ❑ Same for CO....if permit is 5 ppm, then set design to something lower
- ❑ Operators do NOT like to push the envelope!

# Simple Cycle SCR – Design Specs

---

	Units	Design	Actual Operation
SCR Inlet NOx	ppm	25	25
SCR Outlet NOx	ppm	2.5	2.2
DeNOx	%	90	91.2
Ammonia Slip	ppm	<5	<5

# Simple Cycle SCR – Ammonia Slip Monitoring

---

- Depending on the state/permit, ammonia slip may or may not be monitored
- When it's not monitored, it's usually measured periodically by CTM-027 or FTIR
- If it is monitored, control of NO<sub>x</sub> and CO is critical to stay in NH<sub>3</sub> slip compliance

# Simple Cycle SCR – Tempering Air

---

- ❑ Many systems utilize tempering air at the engine exhaust to reduce the flue gas temperature.
  - ❑ Done primarily for SCR to keep gas temperature < 800F
- ❑ Although in theory the systems work, the implementation, performance issues and O&M can be significant
  - ❑ Temperature Distribution
  - ❑ Parasitic loads for TA fans
  - ❑ TA Fan maintenance...more moving parts
  - ❑ Cooling Air Lance design...subject to high turbulence at GT exhaust

# The Need for Flow Modeling...


---

- ❑ Size of system should not dictate whether a system is modeled
  - ❑ Flow modeling should ALWAYS be done. “Duplicates” are not always the case
- ❑ Modeling should be done early, by OEM or catalyst supplier as required
- ❑ Detailed modeling can save time and \$\$ in the long run
- ❑ Physical or CFD are proven methods, but CFD has advantages...
  - Better simulation of GT exhaust
  - Thermal mixing

# Simple Cycle SCR – Fluid Flow Design Considerations

---

- No Boiler Tubes!!
- Many systems with steep angles on Combined Cycle flues do not work in Simple Cycle applications
- High swirl and turbulence from GT...Single perforated plate may not be enough to improve distribution
- Burdens CO catalyst
  - CO Catalyst performance can be hindered
- Poor flow distribution ultimately results in poor ammonia distribution and degraded SCR performance

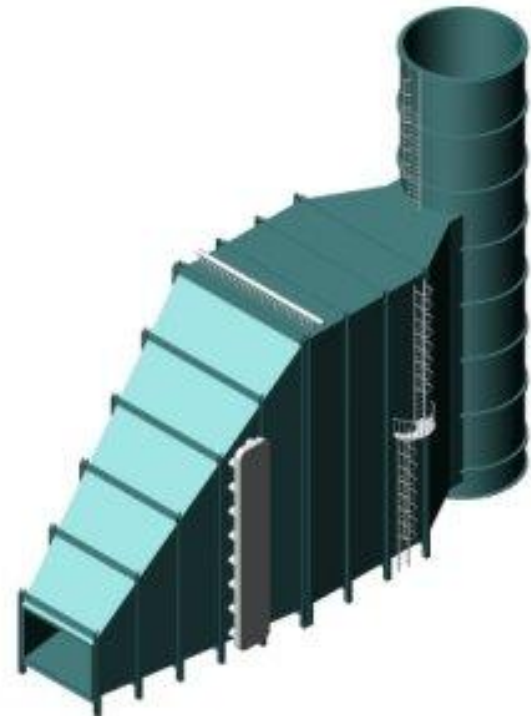

# Simple Cycle SCR – Ammonia Mixing

---

- ❑ AIG typically located directly downstream from CO Catalyst
- ❑ CO Catalyst will significantly reduce turbulence intensity
  - ❑ Metallic catalyst with 200 cells per square inch
- ❑ Even though there may be plenty of injection points, there ammonia and flue gas blending is weak
- ❑ AIG will need a mixing “boost”



# Simple Cycle SCR – AIG Design

---

- ❑ AIG should be designed with ability to tune as much as possible!
- ❑ Systems designed with no tuning capability have very limited flexibility
- ❑ Aspect Ratio comes into play





# Simple Cycle SCR – SCR Catalyst Design

---


- Plate, Honeycomb and Corrugated Catalyst all used successfully in simple cycle applications
- When properly specified, operated and maintained, catalyst should far exceed guarantee life
  - Less deactivation risks in natural gas applications
- Performance problems usually due to system issues..
  - Poor NH<sub>3</sub>/NO<sub>x</sub> Distribution
  - Poor Velocity Distribution
  - Bypass



# Simple Cycle SCR – SCR Structural Design

---

- ❑ Stainless Steel components...higher expansion coefficient than carbon steel
- ❑ System must be designed to accommodate growth vertically and horizontally
- ❑ Vertical growth could be 2-3"
- ❑ Sealing is critical to avoid bypass

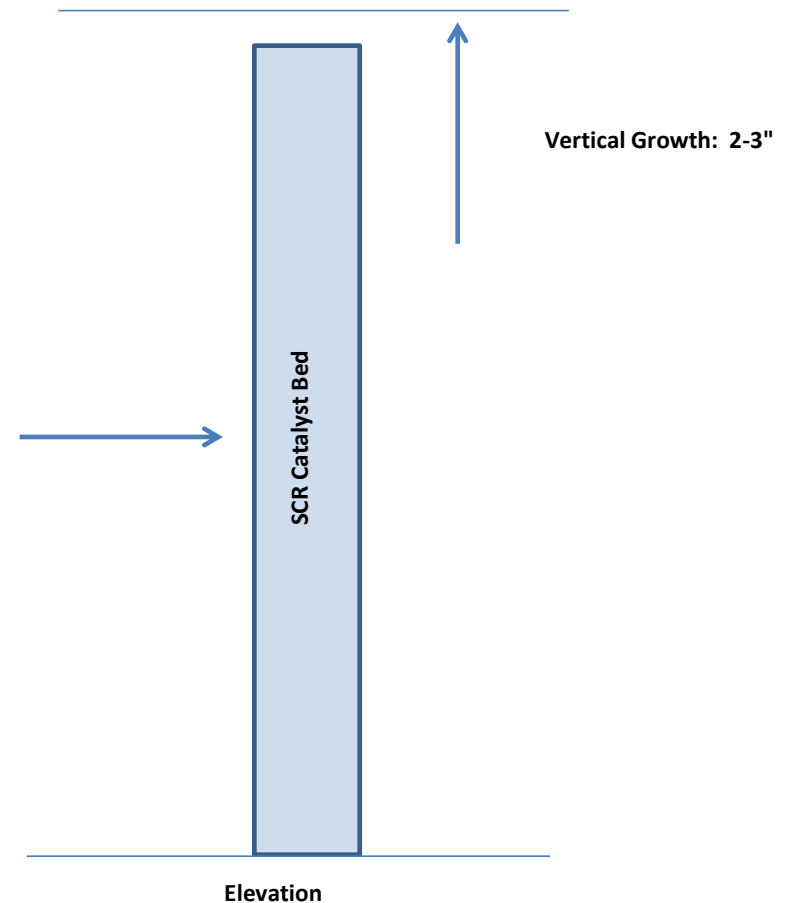

# Simple Cycle SCR – Effect of Improved Seals

---

Configuration	Ammonia Slip, ppmvd @ 15% O <sub>2</sub>
Original Sealing System	6.8
With ENERActive Modified Sealing/Reinforcement System	2.0

# Simple Cycle SCR – Additional Structural Considerations

---

- ❑ Insulation – Can release if not properly addressed
  - ❑ Liner gaps
  - ❑ Access Doors
- ❑ Catalyst Support Structure
  - ❑ Poor design can affect integrity of catalyst modules
  - ❑ Excessive column deflections can have significant effect on bypass
- ❑ Column Deflection
  - ❑ SCR Support Columns to be properly designed for pressure, seismic, etc.
- ❑ Structural Integrity near GT Exhaust
  - ❑ Any devices in this region must be robust...turbulence levels are very high



# Simple Cycle SCR Design - Summary

---

- Proper Design Specifications a Must
- Avoid Tempering Air if possible
- Flow Modeling a Must
- AIG and Ammonia Mixing are critical to performance
- Structural Design can impact Performance
- SCR not a Commodity!



ENERACTIVE  
SOLUTIONS

*Energy Solutions...Efficient Results*